



FALKANGER & SNYDER

Asbestos Consulting Services, Inc.

ZA0000114

"We're On Your Side"

888 South Andrews Avenue, Suite 300 ■ Fort Lauderdale, Florida 33316 ■ TEL: 954-764-8159 ■ FAX: 954-764-8622

Limited Interior Asbestos Inspection & Survey

For

**Daniel J. Nocher
Chief, Energy Management
Eglin Air Force Base
Florida**

Location Tested

**Building # 12
Areas Tested
Dining, Barber Shop, & Alterations Shop
Eglin Air Force Base
Florida**

COMMISSION NO. 14824A

Date: December 13, 2024

Note: This document has been digitally signed and sealed.

IMPORTANT: SAVE THIS DOCUMENT INDEFINITELY

**Contains important documentation that may protect you from future
asbestos liability claims, or the necessity of future inspections.**



FALKANGER & SNYDER

Asbestos Consulting Services, Inc.

ZA0000114

"We're On Your Side"

888 South Andrews Avenue, Suite 300 ■ Fort Lauderdale, Florida 33316 ■ TEL: 954-764-8159 ■ FAX: 954-764-8622

December 13, 2024

Daniel J. Nocher
Chief, Energy Management
Eglin Air Force Base
Florida

RE: Limited Interior Asbestos Survey & Inspection – Project No.: # 14824A
Flooring Removal
Building # 12
Dining, Barber Shop, & Alterations Shop
Eglin Air Force Base, Florida

Daniel,

As per your instructions, a limited interior asbestos survey and inspection at the referenced location, was performed by Environmental Protection Agency (EPA) certified Asbestos Inspector, Corrine C. Brown.

We understand that you will be replacing the existing flooring in the Dining, Barber Shop, and Alterations Shop. The existing flooring consists of multiple layers of vinyl composition tile (V.C.T.) and black and black/yellow mastic.

Current Eglin Air Force Base regulations require all old vinyl flooring and mastic be removed during any flooring replacement.

Using Environmental Protection Agency (EPA) protocol, samples were taken of the following suspect material:

Beige, Gray, Blue, White, & Black Vinyl Composition Tile (V.C.T.)
Black Mastic
Yellow Mastic

The samples were analyzed for asbestos content by McCall and Spero Environmental, located in Louisville, Kentucky. The analysis technique used was EPA 600/R-93/116 Method using Polarized Light Microscopy (PLM), McCall and Spero Environmental is a participating laboratory in the National Institute of Standards and Technology's National Voluntary Laboratory Accreditation Program (NIST/NVLAP). Their NVLAP Lab Code Number is # 101895-0.

The EPA defines ACM (Asbestos Containing Materials) as any material with an asbestos content greater than 1%.

Asbestos was detected in Thirteen (13) of the Fifteen (15) samples that were taken and analyzed.



FALKANGER & SNYDER

ZA0000114

Asbestos Consulting Services, Inc.

"We're On Your Side"

888 South Andrews Avenue, Suite 300 ■ Fort Lauderdale, Florida 33316 ■ TEL: 954-764-8159 ■ FAX: 954-764-8622

The mastic in samples (14824A-01, 02, 03, 05, 07, 08, 09, 10, 11, 12, 13, 14, 15) all contained 3% to 5% Chrysotile asbestos. Therefore, the existing vinyl flooring and mastic must be removed by a state of Florida licensed asbestos abatement contractor using appropriate engineering controls.

In addition, a copy of this asbestos survey must be retained at the project site and be available for review by any governing agency.

If you should need any additional information, please feel free to contact me on my cell (954) 557-7472.

Cordially yours,

Jeff Falkanger
State of Florida - Licensed Asbestos Consultant AF 0000001

Enclosures:

- copy of Sample Location Chart
- copy of Sample Location Drawing
- copy of laboratory analysis
- copy of Chain of Custody
- copy of Certificates of Accreditation
- copy of company license
- copy of consultant's license
- copy of asbestos inspector's certification

POLARIZED LIGHT MICROSCOPY (PLM)

SAMPLE IDENTIFICATION CHART

Job Site:						
Building # 12			Commission No.: 14824A			
Dining, Barber Shop, & Alterations Shop						
Eglin Air Force Base, Florida						
Inspector: Corrine Brown						
Date(s) of sampling: 07/11/24						
Sample No.	Functional Space	Material Location	Homogenous Area	Material Type	Asbestos % & Type	Quantifications
14824A-01	Dining	Floor See Drawing	1	Gray V.C.T. & Black Yellow Mastic	3% Chrysotile in Mastic	See Below
14824A-02	Dining	Floor See Drawing	1	Gray V.C.T. & Black Yellow Mastic	3% Chrysotile in Mastic	See Below
14824A-03	Dining	Floor See Drawing	1	Gray V.C.T. & Black Yellow Mastic	3% Chrysotile in Mastic	Approximatley 528 S.F. Total
14824A-04	Barber Shop	Floor See Drawing	2	Black & Gray V.C.T. & Yellow Mastic	NONE DETECTED	N/A
14824A-05	Barber Shop	Floor See Drawing	2	Gray V.C.T. & Black Mastic	5% Chrysotile in Mastic	Approximatley 392 S.F. Total
14824A-06	Barber Shop	Floor See Drawing	2	Black & Gray V.C.T. & Yellow Mastic	NONE DETECTED	N/A
14824A-07	Alterations Large Room	Floor See Drawing	3	Gray V.C.T. & Black Mastic	5% Chrysotile in Mastic	See Below
14824A-08	Alterations Large Room	Floor See Drawing	3	Gray V.C.T. & Black Mastic	5% Chrysotile in Mastic	See Below
14824A-09	Alterations Large Room	Floor See Drawing	3	Gray V.C.T. & Black Mastic	5% Chrysotile in Mastic	Approximatley 1030 S.F. Total
14824A-10	Alterations Entrance	Floor See Drawing	3	Black Mastic & 4 Layers of V.C.T.	5% Chrysotile in Mastic	See Below

14824A-11	Alterations Entrance	Floor See Drawing	3	Black Mastic & 3 Layers of V.C.T.	5% Chrysotile in Mastic	See Below
14824A-12	Alterations Entrance	Floor See Drawing	4	Black Mastic & 3 Layers of V.C.T.	5% Chrysotile in Mastic	Approximatley 596 S.F.Total
14824A-13	Alterations Dressing Rooms	Floor See Drawing	4	Black Mastic & Gray & White V.C.T.	5% Chrysotile in Mastic	See Below
14824A-14	Alterations Dressing Rooms	Floor See Drawing	4	Black Mastic & Gray & White V.C.T.	5% Chrysotile in Mastic	See Below
14824A-15	Alterations Dressing Rooms	Floor See Drawing	5	Black Mastic & Gray & White V.C.T.	5% Chrysotile in Mastic	Approximatley 188 S.F.Total



Built Environment Testing

Report for:

Jeff Falkanger
Falkanger & Snyder Asbestos Consulting Air Force Project
888 South Andrewes Ave
Fort Lauderdale, FL 33316

Regarding: Eurofins EPK Built Environment Testing, LLC
Project: 14824A; Bld 12 Renovate Flor
EML ID: 3855397

Approved by:

Dates of Analysis:
Asbestos PLM: 11-22-2024

Approved Signatory
Orestes Mendez

Service SOPs: Asbestos PLM (EPA 40CFR App E to Sub E of Part 763 & EPA METHOD 600/R-93-116, SOP EM-AS-S-1267)
NVLAP Lab Code 200738-0

All samples were received in acceptable condition unless noted in the Report Comments portion in the body of the report. The results relate only to the samples as received and tested. The results include an inherent uncertainty of measurement associated with estimating percentages by polarized light microscopy. Measurement uncertainty data for sample results with >1% asbestos concentration can be provided when requested.

Eurofins EPK Built Environment Testing, LLC ("the Company"), a member of the Eurofins Built Environment Testing group of companies, shall have no liability to the client or the client's customer with respect to decisions or recommendations made, actions taken or courses of conduct implemented by either the client or the client's customer as a result of or based upon the Test Results. In no event shall the Company be liable to the client with respect to the Test Results except for the Company's own willful misconduct or gross negligence nor shall the Company be liable for incidental or consequential damages or lost profits or revenues to the fullest extent such liability may be disclaimed by law, even if the Company has been advised of the possibility of such damages, lost profits or lost revenues. In no event shall the Company's liability with respect to the Test Results exceed the amount paid to the Company by the client therefor.

Client: Falkanger & Snyder Asbestos Consulting Air
 Force Project
 C/O: Jeff Falkanger
 Re: 14824A; Bld 12 Renovate Flor

Date of Sampling: 11-07-2024
 Date of Receipt: 11-18-2024
 Date of Report: 12-11-2024

ASBESTOS PLM REPORT

Total Samples Submitted: 15
Total Samples Analyzed: 15
Total Samples with Layer Asbestos Content > 1%: 13

Location: 14824A-1-1, Vinyl Tile & Mastic

Lab ID-Version‡: 19072626-1

Sample Layers	Asbestos Content
Black/Yellow Mastic	3% Chrysotile
Gray Floor Tile	ND
Sample Composite Homogeneity: Moderate	

Location: 14824A-1-2, Vinyl Tile & Mastic

Lab ID-Version‡: 19072627-1

Sample Layers	Asbestos Content
Black/Yellow Mastic	3% Chrysotile
Gray Floor Tile	ND
Sample Composite Homogeneity: Moderate	

Location: 14824A-1-3, Vinyl Tile & Mastic

Lab ID-Version‡: 19072628-1

Sample Layers	Asbestos Content
Black/Yellow Mastic	3% Chrysotile
Gray Floor Tile	ND
Sample Composite Homogeneity: Moderate	

Location: 14824A-2-4, Vinyl Tile & Mastic

Lab ID-Version‡: 19072629-1

Sample Layers	Asbestos Content
Black Floor Tile	ND
Yellow Mastic	ND
Gray Floor Tile	ND
Sample Composite Homogeneity: Moderate	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Falkanger & Snyder Asbestos Consulting Air
 Force Project
 C/O: Jeff Falkanger
 Re: 14824A; Bld 12 Renovate Flor

Date of Sampling: 11-07-2024
 Date of Receipt: 11-18-2024
 Date of Report: 12-11-2024

ASBESTOS PLM REPORT

Location: 14824A-2-5, Vinyl Tile & Mastic

Lab ID-Version‡: 19072630-1

Sample Layers	Asbestos Content
Black Mastic	5% Chrysotile
Gray Floor Tile	ND
Sample Composite Homogeneity: Moderate	

Location: 14824A-2-6, Vinyl Tile & Mastic

Lab ID-Version‡: 19072631-1

Sample Layers	Asbestos Content
Black Floor Tile	ND
Yellow Mastic	ND
Gray Floor Tile	ND
Sample Composite Homogeneity: Moderate	

Location: 14824A-3-7, Vinyl Tile & Mastic

Lab ID-Version‡: 19072632-1

Sample Layers	Asbestos Content
Black Mastic	5% Chrysotile
Gray Floor Tile	ND
Sample Composite Homogeneity: Moderate	

Location: 14824A-3-8, Vinyl Tile & Mastic

Lab ID-Version‡: 19072633-1

Sample Layers	Asbestos Content
Black Mastic	5% Chrysotile
Gray Floor Tile	ND
Sample Composite Homogeneity: Moderate	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Falkanger & Snyder Asbestos Consulting Air
 Force Project
 C/O: Jeff Falkanger
 Re: 14824A; Bld 12 Renovate Flor

Date of Sampling: 11-07-2024
 Date of Receipt: 11-18-2024
 Date of Report: 12-11-2024

ASBESTOS PLM REPORT

Location: 14824A-3-9, Vinyl Tile & Mastic

Lab ID-Version‡: 19072634-1

Sample Layers	Asbestos Content
Black Mastic	5% Chrysotile
Gray Floor Tile	ND
Sample Composite Homogeneity: Moderate	

Location: 14824A-4-10, VCT and Mastic

Lab ID-Version‡: 19072635-1

Sample Layers	Asbestos Content
Black Mastic	5% Chrysotile
Gray Floor Tile	ND
Yellow Mastic	ND
Blue Floor Tile	ND
Transparent Mastic	ND
White Floor Tile	ND
Sample Composite Homogeneity: Moderate	

Location: 14824A-4-11, VCT and Mastic

Lab ID-Version‡: 19072636-1

Sample Layers	Asbestos Content
Black Mastic	5% Chrysotile
Gray Floor Tile	ND
Yellow Mastic	ND
Blue Floor Tile	ND
Transparent Mastic	ND
White Floor Tile	ND
Sample Composite Homogeneity: Moderate	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Falkanger & Snyder Asbestos Consulting Air
 Force Project
 C/O: Jeff Falkanger
 Re: 14824A; Bld 12 Renovate Flor

Date of Sampling: 11-07-2024
 Date of Receipt: 11-18-2024
 Date of Report: 12-11-2024

ASBESTOS PLM REPORT

Location: 14824A-4-12, VCT and Mastic

Lab ID-Version‡: 19072637-1

Sample Layers	Asbestos Content
Black Mastic	5% Chrysotile
Gray Floor Tile	ND
Yellow Mastic	ND
Blue Floor Tile	ND
Transparent Mastic	ND
White Floor Tile	ND
Sample Composite Homogeneity:	Moderate

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Client: Falkanger & Snyder Asbestos Consulting Air
 Force Project
 C/O: Jeff Falkanger
 Re: 14824A; Bld 12 Renovate Flor

Date of Sampling: 11-07-2024
 Date of Receipt: 11-18-2024
 Date of Report: 12-11-2024

ASBESTOS PLM REPORT

Location: 14824A-5-13, VCT and Mastic

Lab ID-Version‡: 19072638-1

Sample Layers	Asbestos Content
Black Mastic	5% Chrysotile
Gray Floor Tile	ND
Yellow Mastic	ND
White Floor Tile	ND
Sample Composite Homogeneity: Moderate	

Location: 14824A-5-14, VCT and Mastic

Lab ID-Version‡: 19072639-1

Sample Layers	Asbestos Content
Black Mastic	5% Chrysotile
Gray Floor Tile	ND
Yellow Mastic	ND
White Floor Tile	ND
Sample Composite Homogeneity: Moderate	

Location: 14824A-5-15, VCT and Mastic

Lab ID-Version‡: 19072640-1

Sample Layers	Asbestos Content
Black Mastic	5% Chrysotile
Gray Floor Tile	ND
Yellow Mastic	ND
White Floor Tile	ND
Sample Composite Homogeneity: Moderate	

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

All components not quantified as asbestos content and non-asbestos content are considered to be non-fibrous matrix components. Matrix components may include, but are not limited to, gypsum, paint, silicate minerals, vinyl, binder, calcium carbonate, tar, and foam.

Inhomogeneous samples are separated into homogeneous subsamples and analyzed individually. ND means no fibers were detected. When detected, the minimum detection and reporting limit is less than 1% unless point counting is performed. Floor tile samples may contain large amounts of interference material and it is recommended that the sample be analyzed by gravimetric point count analysis to lower the detection limit and to aid in asbestos identification.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

Eurofins EPK Built Environment Testing, LLC
6340 NW 5th Way, Ft. Lauderdale, FL 33309
(866) 871-1984 www.eurofinsus.com/Built

Client: Falkanger & Snyder Asbestos Consulting Air
Force Project
C/O: Jeff Falkanger
Re: 14824A; Bld 12 Renovate Flor

Date of Sampling: 11-07-2024
Date of Receipt: 11-18-2024
Date of Report: 12-11-2024

ASBESTOS PLM REPORT

PROJECT ANALYST AND SIGNATORY REPORT

Project Analyst



Analyst: Katelyn Carpi

The test report shall not be reproduced except in full, without written approval of the laboratory. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the federal government. The Company reserves the right to dispose of all samples after a period of thirty (30) days, according to all state and federal guidelines, unless otherwise specified.

‡ A "Version" indicated by "-x" after the Lab ID# with a value greater than 1 indicates a sample with amended data. The revision number is reflected by the value of "x".

East: (866) 871-1984
Central: (800) 851-4802
West: (866) 888-6653

Quant Environment Test log

WEATHER	Fog	Rain	Snow	Wind	Cloud
	None	Light	Moderate	Heavy	
LVL	1	2	3	4	5
	6	7	8	9	10



CONTACT INFORMATION

Company: **FALKANGER & SNYDER**
 Contact: **JETT FALKANGER**
 Phone: **(954) 557-7472**
 Address: **808 S. ANDREWS AVE. FLORISSHAM**
 Special Instructions: **FOR Payment, please bill Corinne Brown**

PROJECT INFORMATION

Project ID: **14824A**
 Project Description: **Bld 12 Renovate Floor**
 Project Start Date/Time: **7/11/2024**
 Project End Date/Time: **7/11/2024**
 Project Zip Code: **33542**
 Project Location: **Corinne Brown**

TURN AROUND TIME CODES - (TAT)

STD - Standard (Default)
 ND - Next Business Day
 SD - Same Business Day
 WH - Weekend/Holiday/ASAP

SAMPLE ID	DESCRIPTION	Sample Type (Below)	TAT (Above)	Total Volume/Area (as applicable)	NOTES (Time of day, Temp, RH, etc.)	RELINQUISHED BY		DATE & TIME	
						Signature	Name	Signature	Date
14824A-1	DINING ROOM (see Attached Sheets)	B STD	STD			<i>[Signature]</i>	Corinne Brown	7/13/2024	
"	"	B STD	STD						
14824A-2	BARBER SHOP (see Attached Sheets)	B STD	STD						
"	"	B STD	STD						
14824A-3	ALTERATIONS, Lg Rm	B STD	STD						
"	"	B STD	STD						
14824A-4	ALTERATIONS, Entrance	B STD	STD						
"	"	B STD	STD						
14824A-5	ALTERATIONS, Dressing Room	B STD	STD						
"	"	B STD	STD						
"	"	B STD	STD						

SAMPLE TYPE CODES

BC - BioCassette	CP - Contact Plate	T - Tape	O - Other:
AIS - Andersen	ST - Spore Trap	SW - Swab	
SAS - Surface Air Sampler	B - Bulk	SO - Soil	
NP - Non-potable Water	P - Potable Water	D - Dust	

Non-Confurable		Contact Plate	
Spore Trap	Tape, Swab, Bulk	Quantitative	Other: (please specify test)
Spore Trap Analyze	Direct Microscopic Exam (Qualitative)	Quantitative Spore Count (direct exam)	Dust Characterization
Other biological particles - supplement	Other Microscopic Exam (Qualitative)	Quantitative spore count direct exam	Legionella culture
			Gram Stain and Counts (Culture Air and Surface Decants)
			Total Coliform, E.coli (Presence/Absence)
			Quantitative Sewage Screen
			OTHER: (please specify test)
			Asbestos in Air - PCM Airborne Fiber Count (NIOSH 7400)
			Asbestos Bulk - PLM
			Lead (Pb) - Flame AA
			PCR (please specify test)
			Allergens (please specify test)

RECEIVED BY	DATE & TIME
<i>[Signature]</i>	11/18/24
	12.20



003855397

**POLARIZED LIGHT MICROSCOPY (PLM),
SAMPLE IDENTIFICATION CHART**

Job Site: BLDG. 12
Eglin AFB, FL 32542

Commission No.: 14824A

Inspector: Corinne Brown

Date(s) of sampling: 7/11/2024

Sample No.	Functional Space	Material Location	Homogenous Area	Material Type	Asbestos % & Type	Quantifications
1	DINING ROOM	FLOOR see Drawing	1	VINYL tile + MASTIC		
2	DINING ROOM	FLOOR See Drawing	1	VINYL tile + MASTIC		
3	DINING ROOM	FLOOR see DRAWING	1	"		
4	BARBER SHOP	FLOOR See DWG	2	VINYL tile + MASTIC		
5	"	"	2	"		
6	"	"	2	"		
7	Alterations Lg Rm See DWG	FLOOR See DWG	3	VINYL tile + MASTIC		
8	Alterations Lg Rm	"	3	"		
9	"	"	3	"		

JS 11/8/24
1220



003855397

POLARIZED LIGHT MICROSCOPY (PLM) SAMPLE IDENTIFICATION CHART

Job Site: Bldg 12
Eglin AFB, FL 32542

Commission No.: 14824A


Inspector: Corinne Brown

Date(s) of sampling: 7/11/2024

Sample No.	Functional Space	Material Location	Homogenous Area	Material Type	Asbestos % & Type	Quantifications
10	Alterations Entrance	Floor see dwg	4			
11	"	"	4			
12	"	"	4			
13	Alteration Dressing Room	Floor see Drawing	5			
14	"	"	5			
15	"	"	5			

JS 11/18/24 12:20

United States Department of Commerce
National Institute of Standards and Technology

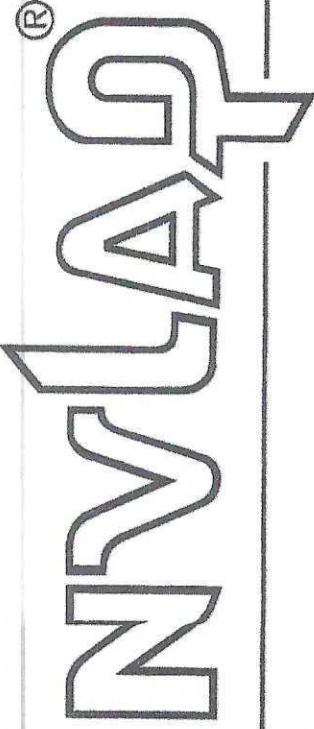

Certificate of Accreditation to ISO/IEC 17025:2017

NVLAP LAB CODE: 200738-0

Eurofins EMLab P&K
Fort Lauderdale, FL

is accredited by the National Voluntary Laboratory Accreditation Program for specific services,
listed on the Scope of Accreditation, for:

Asbestos Fiber Analysis

This laboratory is accredited in accordance with the recognized International Standard ISO/IEC 17025:2017.
This accreditation demonstrates technical competence for a defined scope and the operation of a laboratory quality management system (refer to joint ISO-ILAC-IAF Communiqué dated January 2009).

2024-01-01 through 2024-12-31
Effective Dates

A handwritten signature in blue ink, which appears to read "Peter S. Laman".

For the National Voluntary Laboratory Accreditation Program



SCOPE OF ACCREDITATION TO ISO/IEC 17025:2017

Eurofins EMLab P&K
6301 NW 5th Way, Suite 1410
Fort Lauderdale, FL 33309
Mrs. Tracy Garcia
Phone: 770-368-2171
Email: tracy.garcia@et.eurofinsus.com
<http://www.emlab.com>

ASBESTOS FIBER ANALYSIS

NVLAP LAB CODE 200738-0

Bulk Asbestos Analysis

Code

Description

18/A01

EPA -- 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples

18/A03

EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials

A handwritten signature in blue ink, appearing to read "Tracy Garcia", written over a horizontal line.

For the National Voluntary Laboratory Accreditation Program



Ron DeSantis, Governor

Melanie S. Griffin, Secretary



**STATE OF FLORIDA
DEPARTMENT OF BUSINESS AND PROFESSIONAL REGULATION**

ASBESTOS LICENSING UNIT

THE ASBESTOS BUSINESS ORGANIZATION HEREIN IS LICENSED UNDER THE
PROVISIONS OF CHAPTER 469, FLORIDA STATUTES

FALKANGER & SNYDER ASBESTOS CONSULTING SVCS

JEFF FALKANGER
888 SOUTH ANDREWS AVENUE
SUITE 300
FORT LAUDERDALE FL 33316

LICENSE NUMBER: ZA0000114

EXPIRATION DATE: NOVEMBER 30, 2025

Always verify licenses online at MyFloridaLicense.com



Do not alter this document in any form.

This is your license. It is unlawful for anyone other than the licensee to use this document.



Ron DeSantis, Governor

Melanie S. Griffin, Secretary



STATE OF FLORIDA
DEPARTMENT OF BUSINESS AND PROFESSIONAL REGULATION

ASBESTOS LICENSING UNIT

THE ASBESTOS CONSULTANT HEREIN IS LICENSED UNDER THE
PROVISIONS OF CHAPTER 469, FLORIDA STATUTES

FALKANGER, JEFFREY

FALKANGER & SNYDER ASBESTOS CONSULT. SV
888 S ANDREWS AVE STE 300
FT LAUDERDALE FL 33316-3110

LICENSE NUMBER: AF00000001

EXPIRATION DATE: NOVEMBER 30, 2026

Always verify licenses online at MyFloridaLicense.com



ISSUED: 12/05/2024

Do not alter this document in any form.

This is your license. It is unlawful for anyone other than the licensee to use this document.

certifies

Corinne C. Brown

96 CEG/CENPP 501 DeLeon St., ste. 100, Eglin AFB, FL 32542

Having passed a 25-question exam with a score of 70% or higher has successfully met training requirements for

Asbestos Refresher: Inspector

FDBPR Asbestos Licensing Unit: Provider #0000995; Course #FL49-0004731 (1/2 Day; 3.40 Contact Hours)
(Reaccreditation for Inspector under TSCA Title II/AHERA)

Conducted

08/01/2023

Certificate #: 240015-9309

Exam Date: 08/01/2023

EPA accreditation expires: 08/01/2024

Principal Instructor: Brian Duchene, PE, LAC

CEUs: .4

FBPR LAC: #0000995; Course #0004731

FBPE CEHs: #0004021; Course #0009083/Educational Institutions: 4 CEHs



Andrew Campbell, Director