
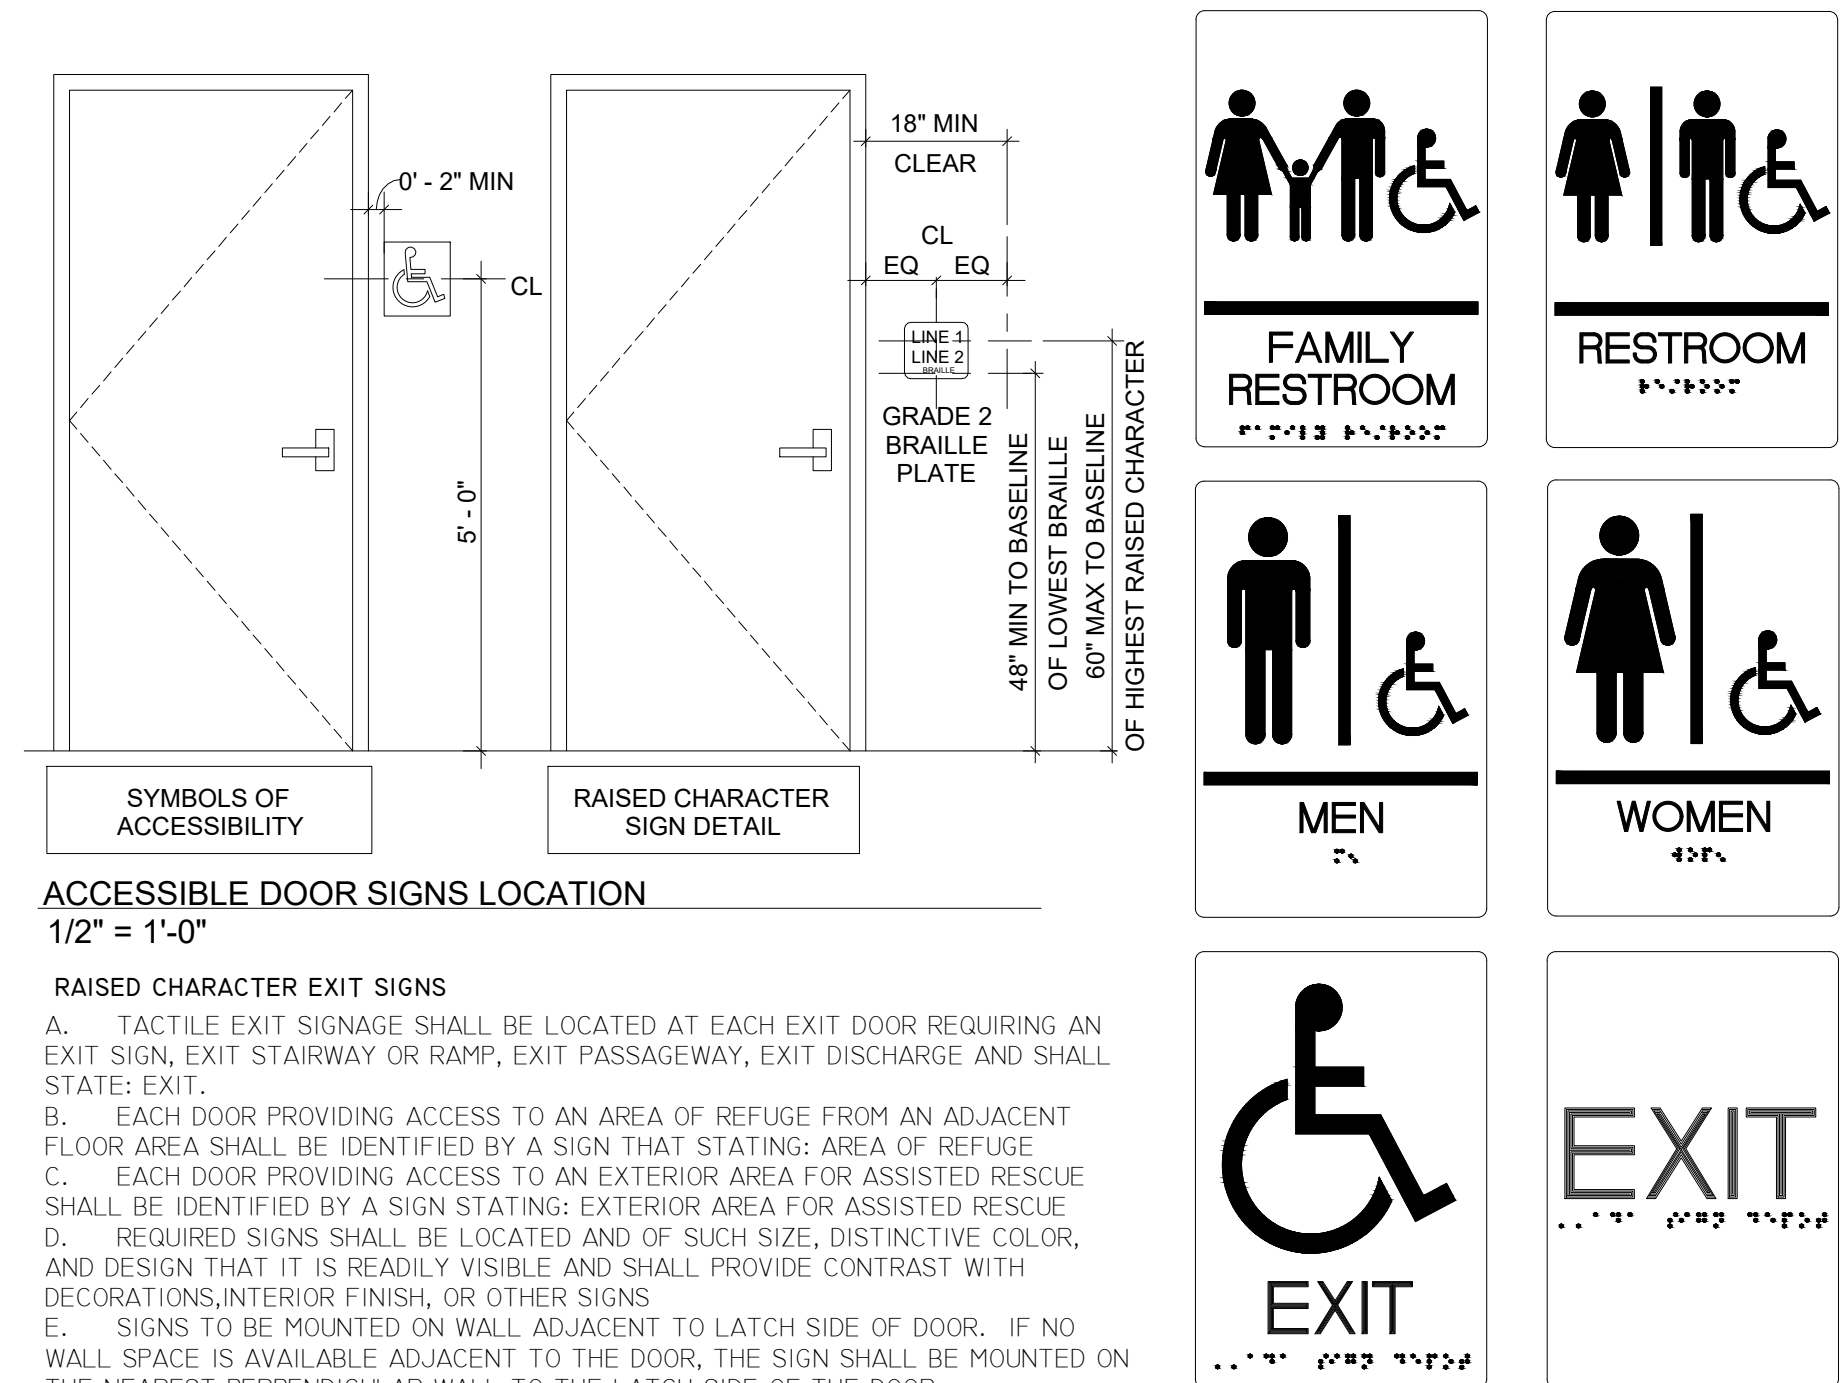
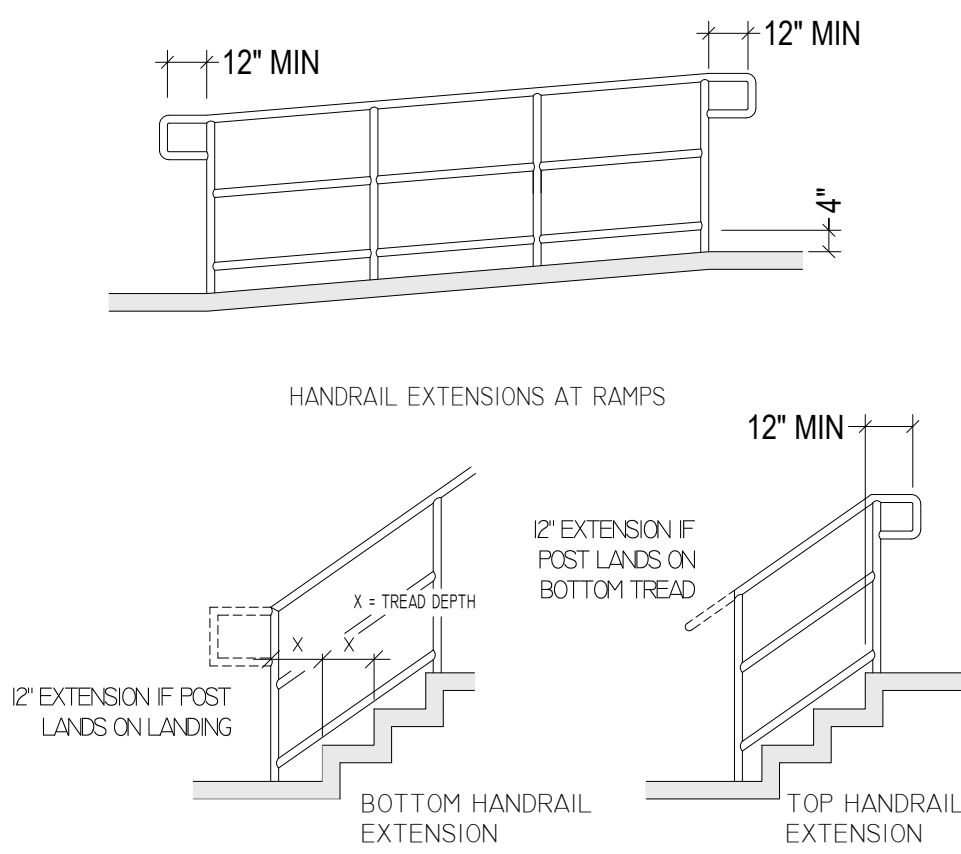
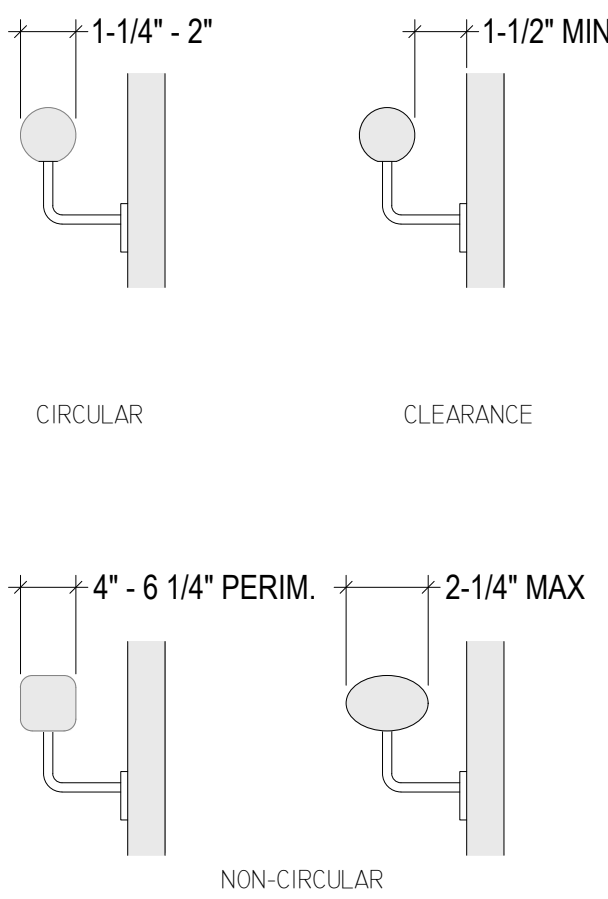
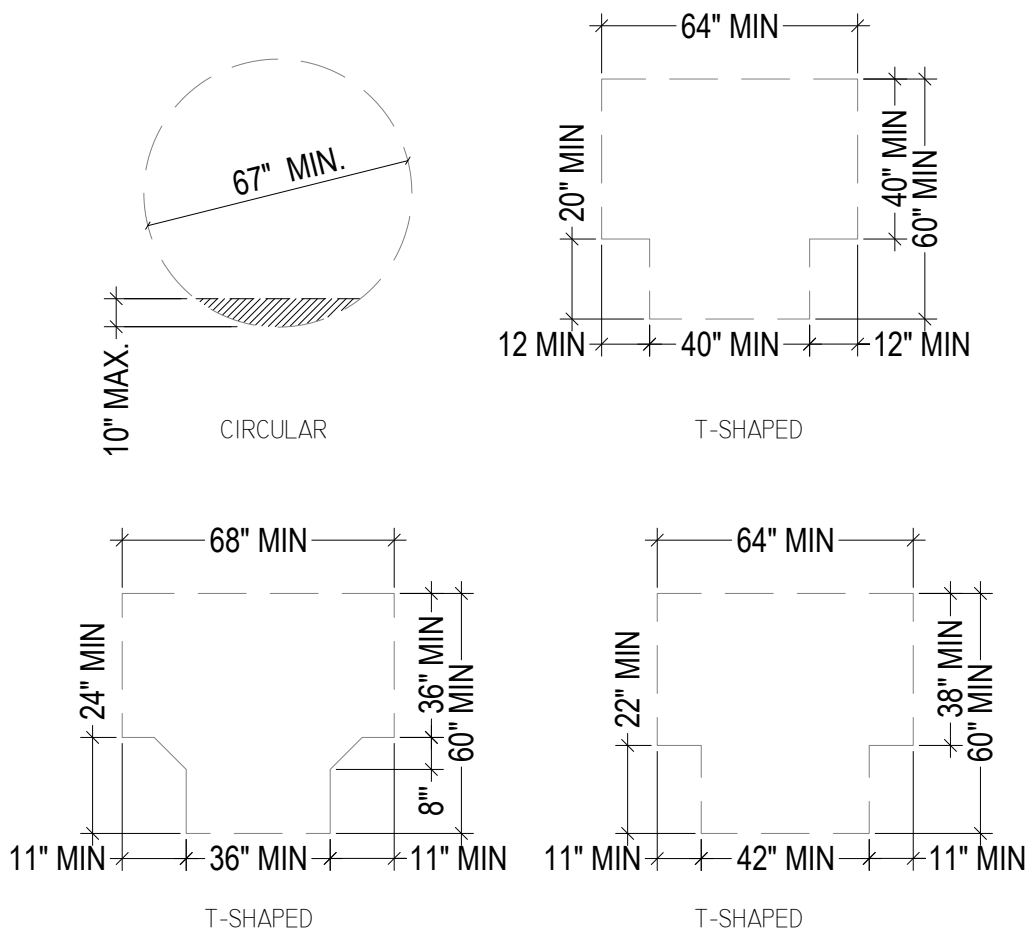


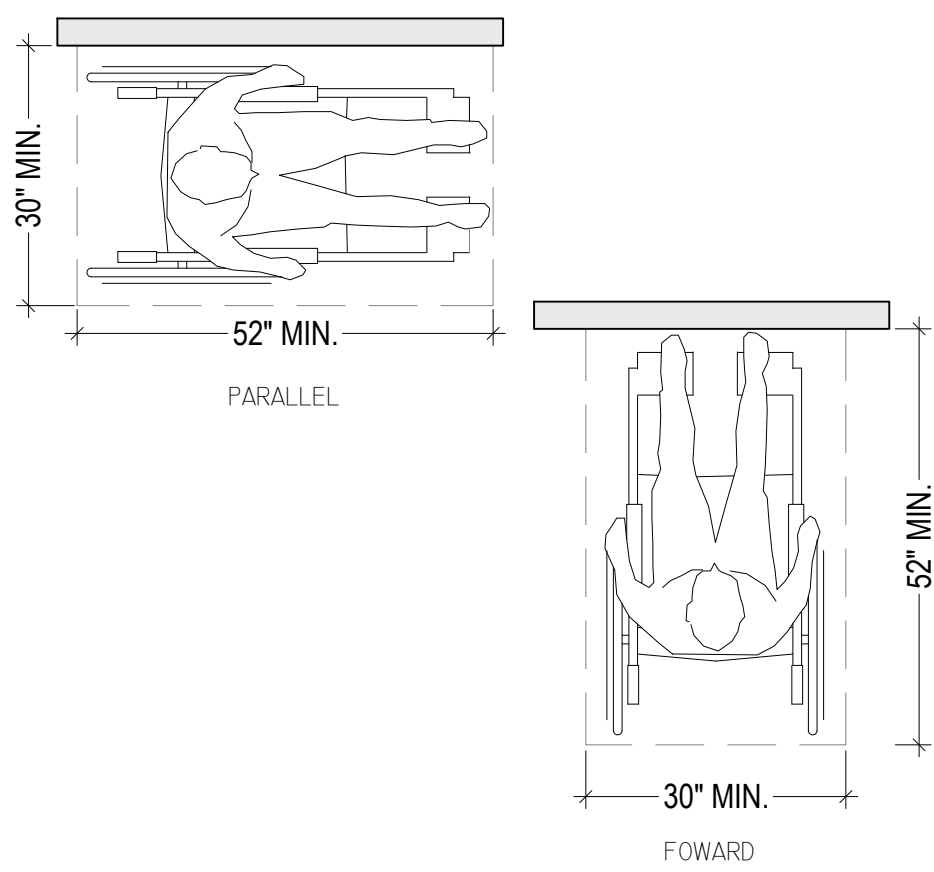

GENERAL NOTES:

- I. THE SITE, BUILDING AND ACCESSIBLE ELEMENTS SHALL MEET THE REQUIREMENTS OF THE 2017 EDITION OF THE ANSI/ICC. A117.1.

2. THRESHOLDS SHALL NOT EXCEED 1/2" A.F.F.

3. RAMP SLOPES SHALL NOT EXCEED 1:12.

4. HANDICAP RAMPS AT CURBS SHALL BE PROVIDED WITH DETECTABLE WARNING SURFACES.

5. MIN. 44" WIDE WALKWAY STRIPES SHALL BE PAINTED ON THE SURFACES OF ACCESS ROUTES TO PUBLIC WAYS ACROSS ANY TRAFFIC AREAS.

6. THE MANEUVERING CLEARANCE AT DOORS WITH CLOSERS THAT MUST BE PULLED TO BE OPENED SHALL BE 18" WIDE BEYOND THE STRIKE SIDE OF THE DOOR x 60" DEEP.

7. ALL DOORWAYS SHALL HAVE A MINIMUM CLEAR OPENING OF 32" MEASURED BETWEEN THE FACE OF THE DOOR AND THE STOP.

8. HINGED EXTERIOR DOORS SHALL HAVE A MAXIMUM PULLING/PUSHING FORCE OF 15 LBF.

9. HINGED INTERIOR DOORS SHALL HAVE A MAXIMUM PULLING/PUSHING FORCE OF 5 LBF.

10. ALL HANDLES, LATCHES AND LOCKS ON DOORS SHALL BE LEVER STYLE.









- II. WHERE THE VERTICAL CLEARANCE OF AN AREA ADJOINING AN ACCESSIBLE ROUTE OF TRAVEL IS LESS THAN 80" BUT MORE THAN 27", A CONTINUOUS PERMANENT BARRIER SHALL BE INSTALLED TO PREVENT TRAFFIC INTO SUCH AREAS OF REDUCED CLEARANCE.

12. AN ACCESSIBLE ROUTE OF TRAVEL SHALL BE PROVIDED TO CONNECT ALL BUILDINGS AND FACILITIES ON SITE.








13. ILLUMINATION OF 1 FOOT CANDLE SHALL BE PROVIDED ALONG EXTERIOR ACCESSIBLE ROUTES OF TRAVEL AND ACCESSIBLE PARKING SPACES.

14. PROVIDE ABOVE GROUND SIGNAGE IDENTIFYING ACCESSIBLE PARKING, DEPICTING THE INTERNATIONAL SYMBOL FOR ACCESS. AN ADDITIONAL SIGN IS REQUIRED AT VAN PARKING SHALL INCLUDE THE PHRASE "VAN ACCESSIBLE".

15. ACCESSIBILITY SIGNAGE SHALL BE INSTALLED ON THE WALL ADJACENT TO THE LATCH SIDE OF DOORS (NOT ON THE DOOR), CENTERED AT 60" A.F.F.

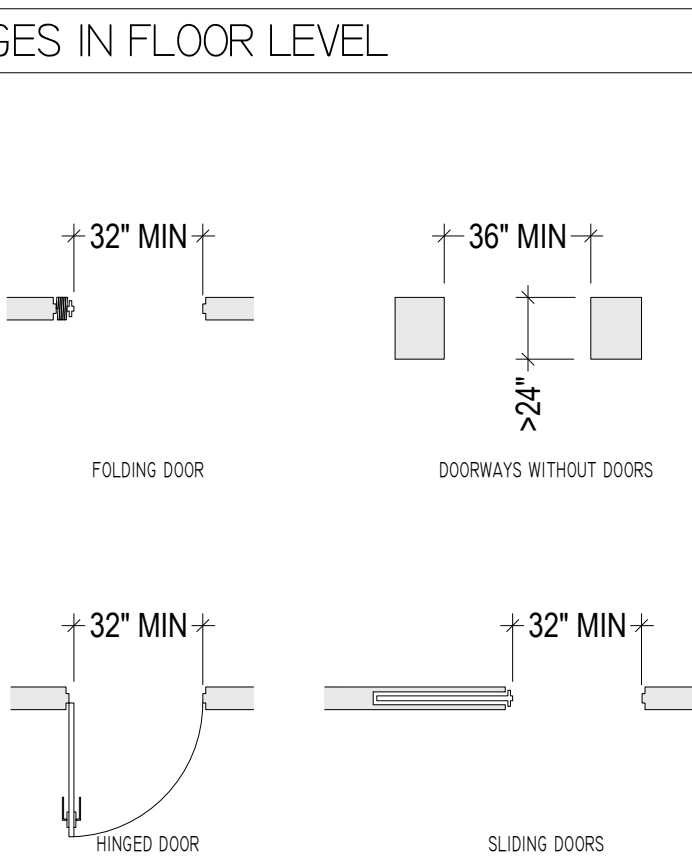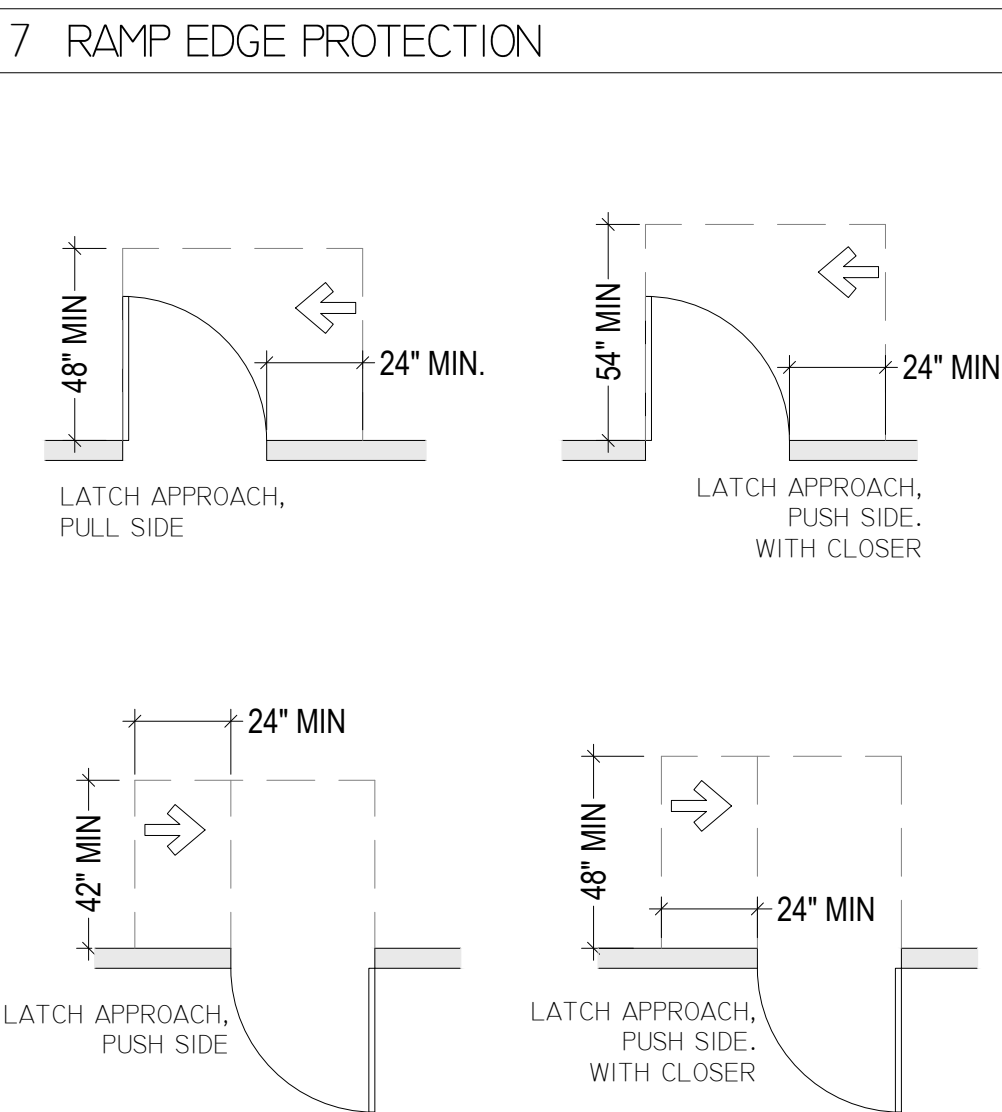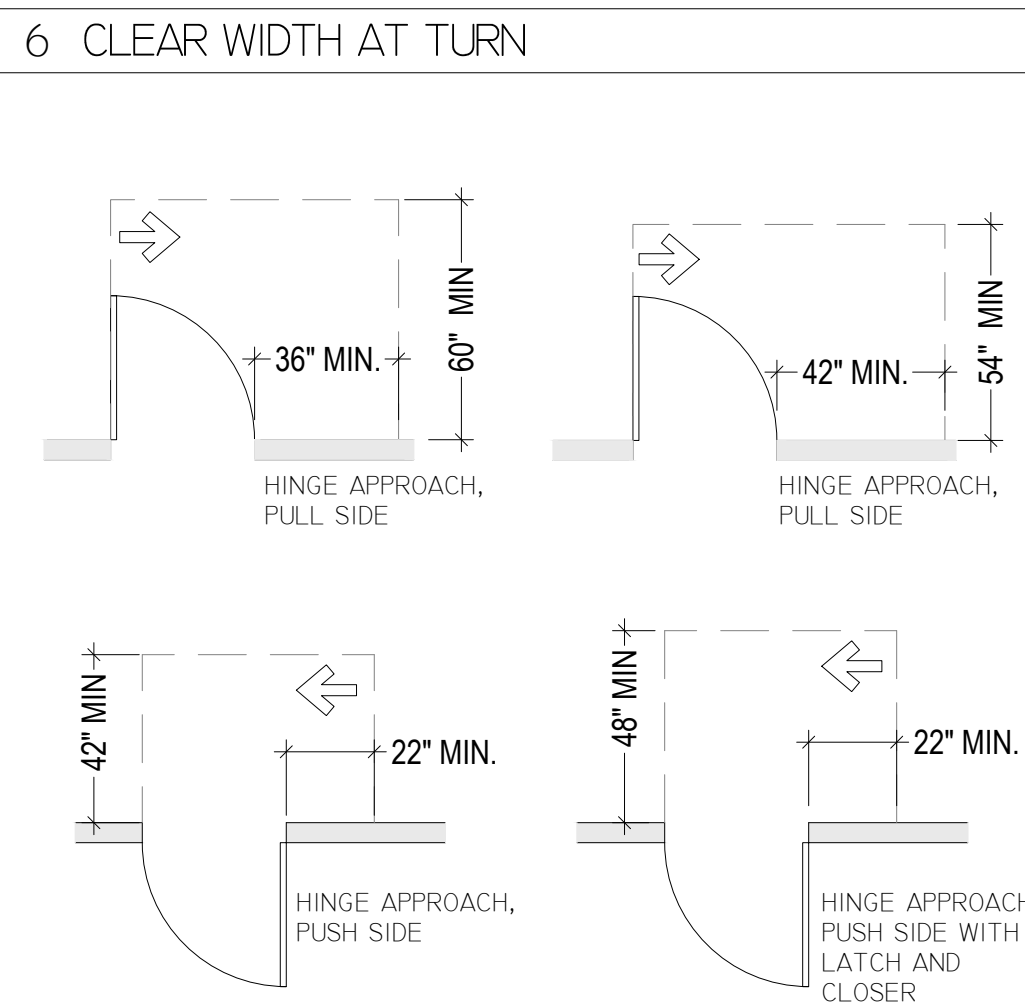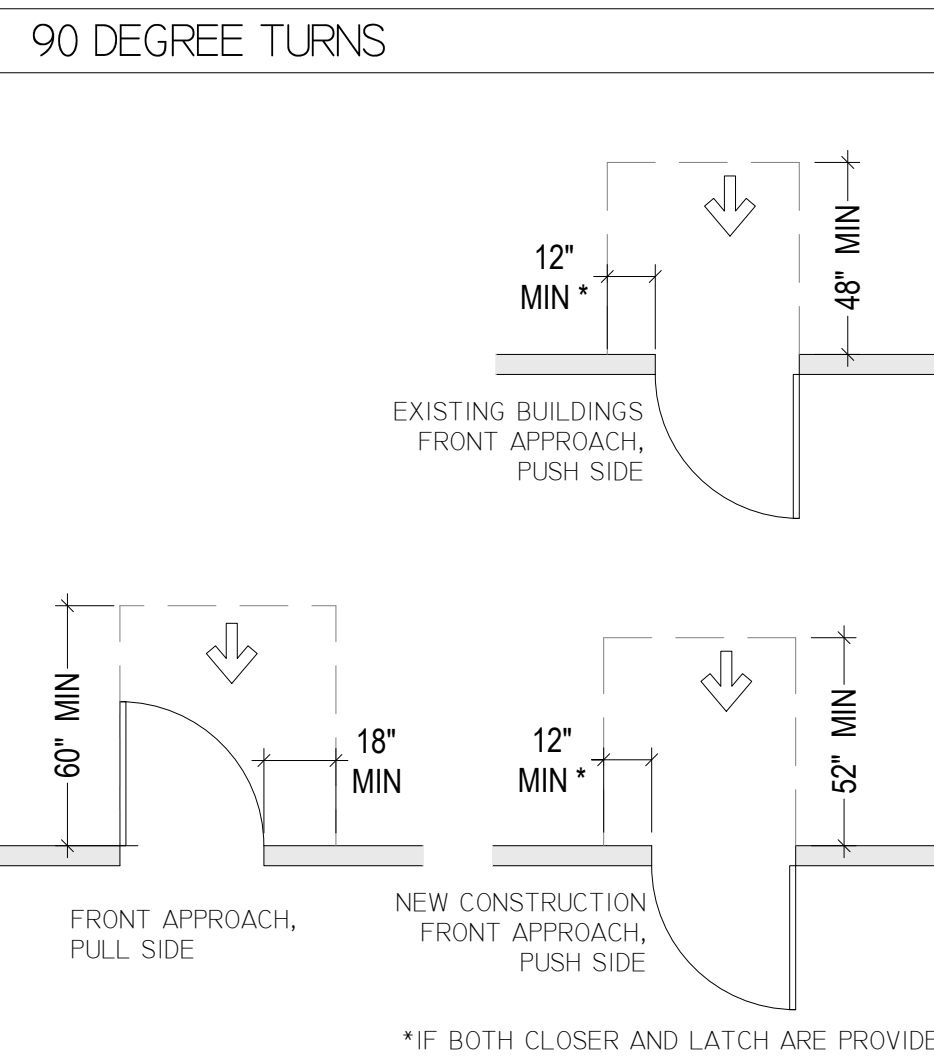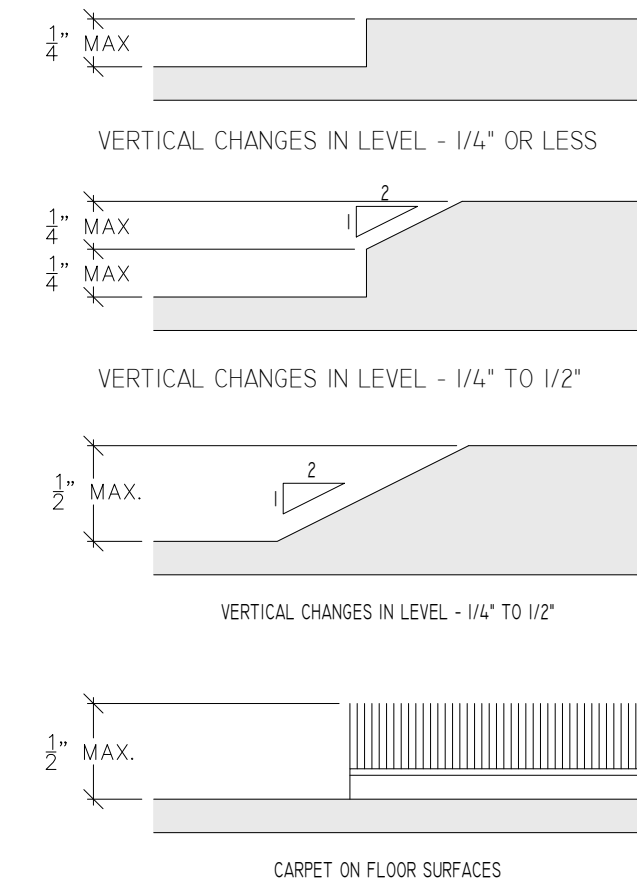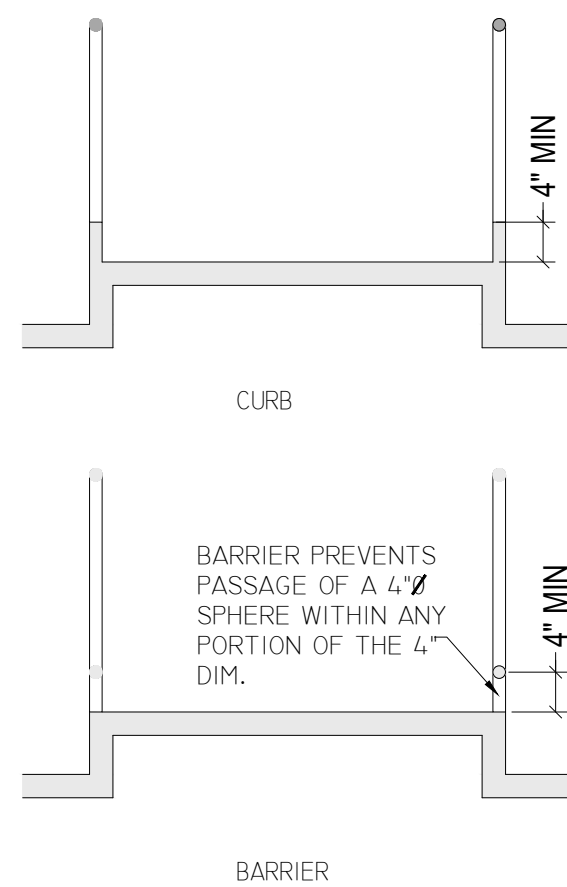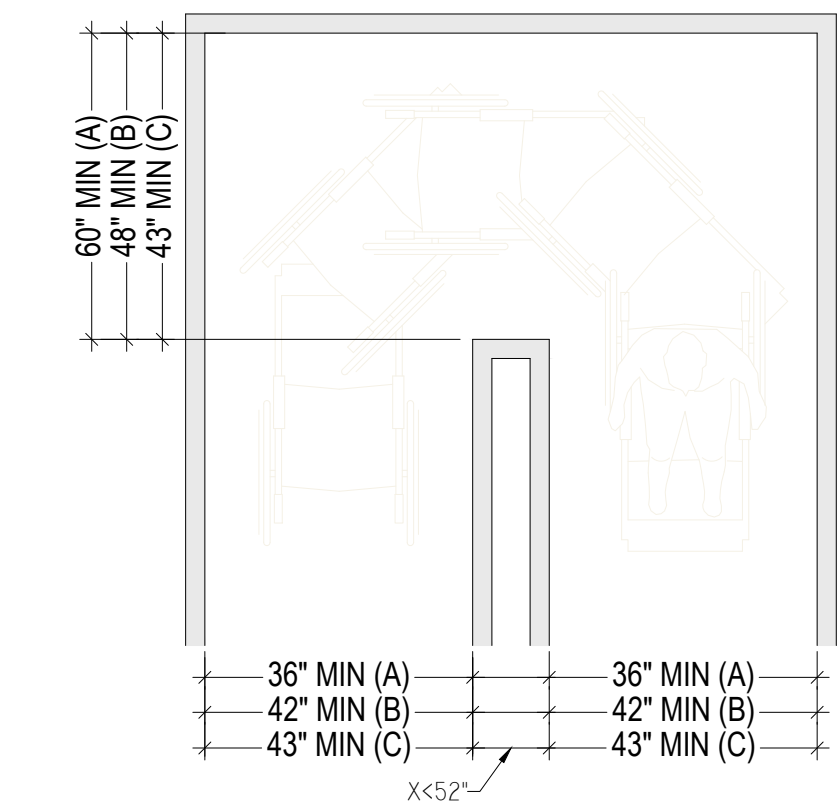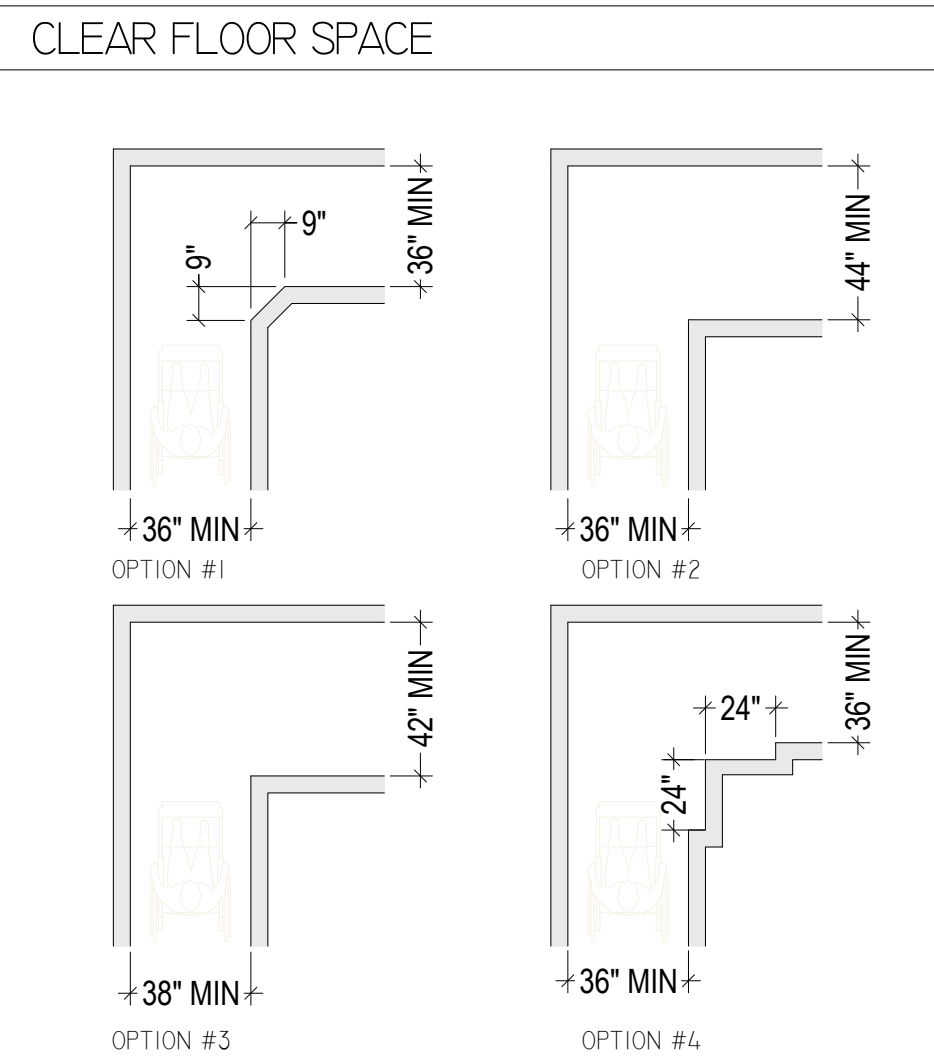

12 CLEAR WIDTH OF DOORWAYS

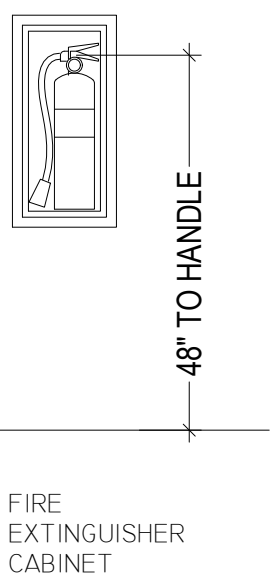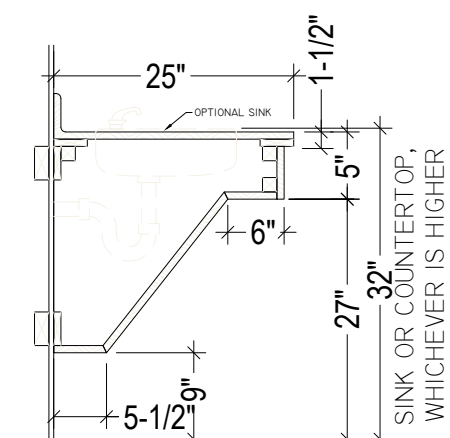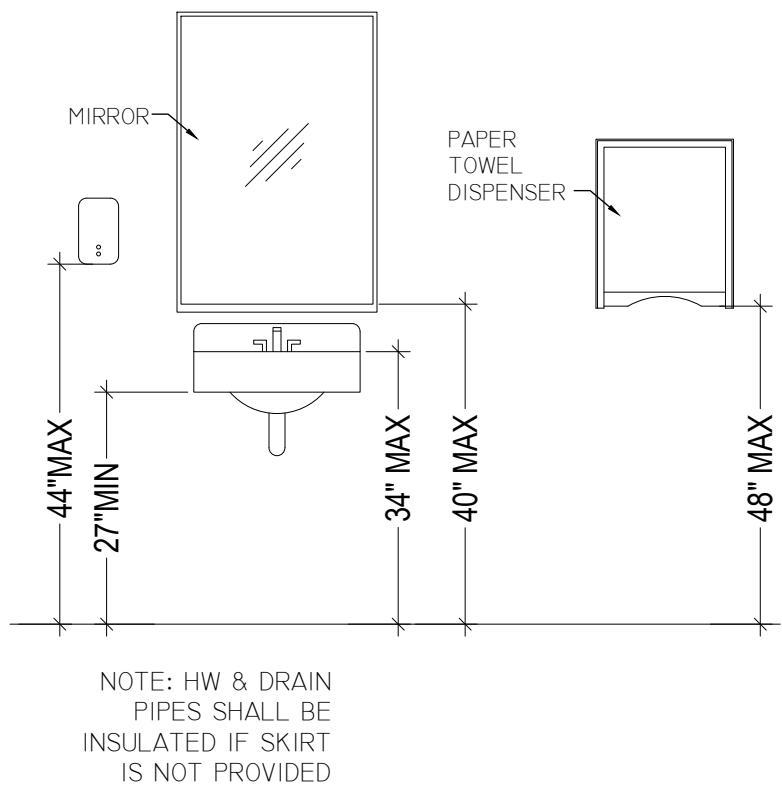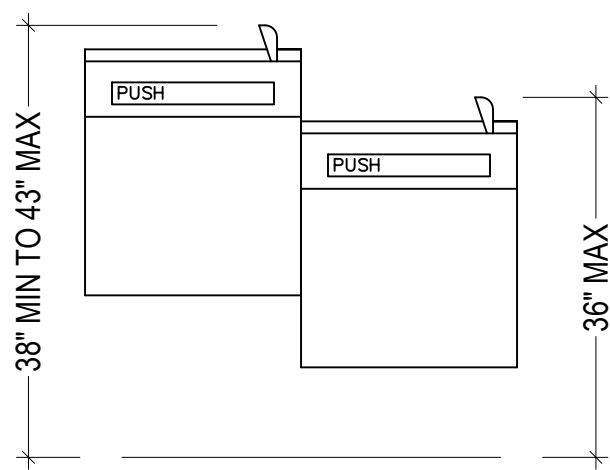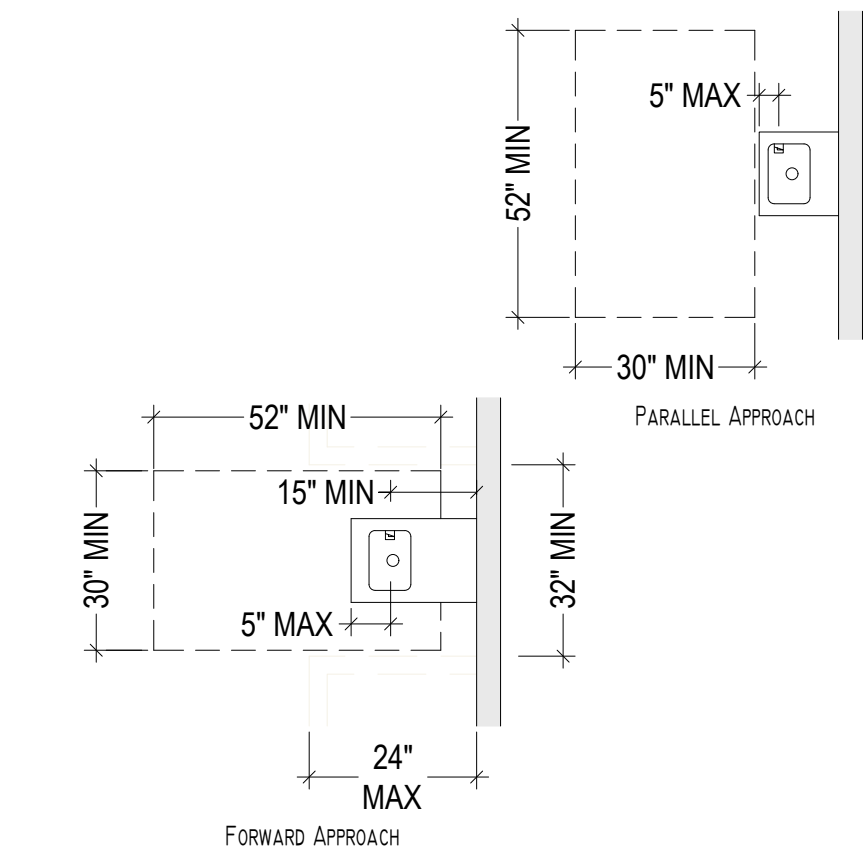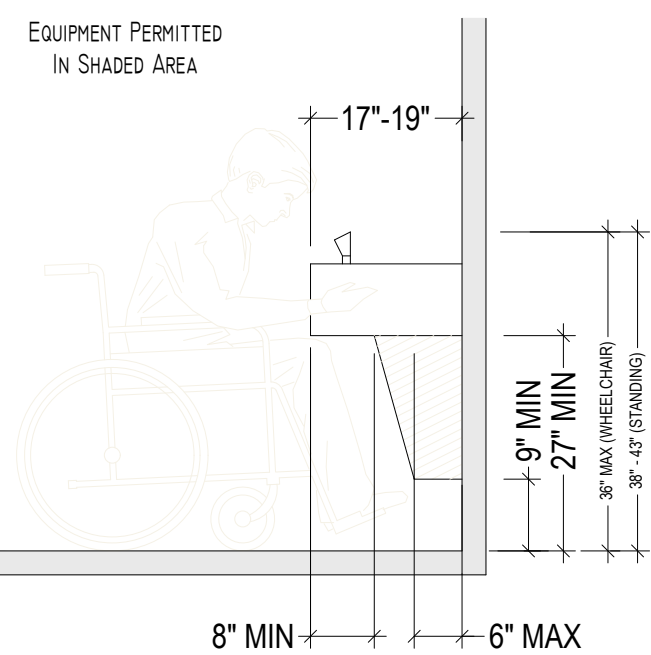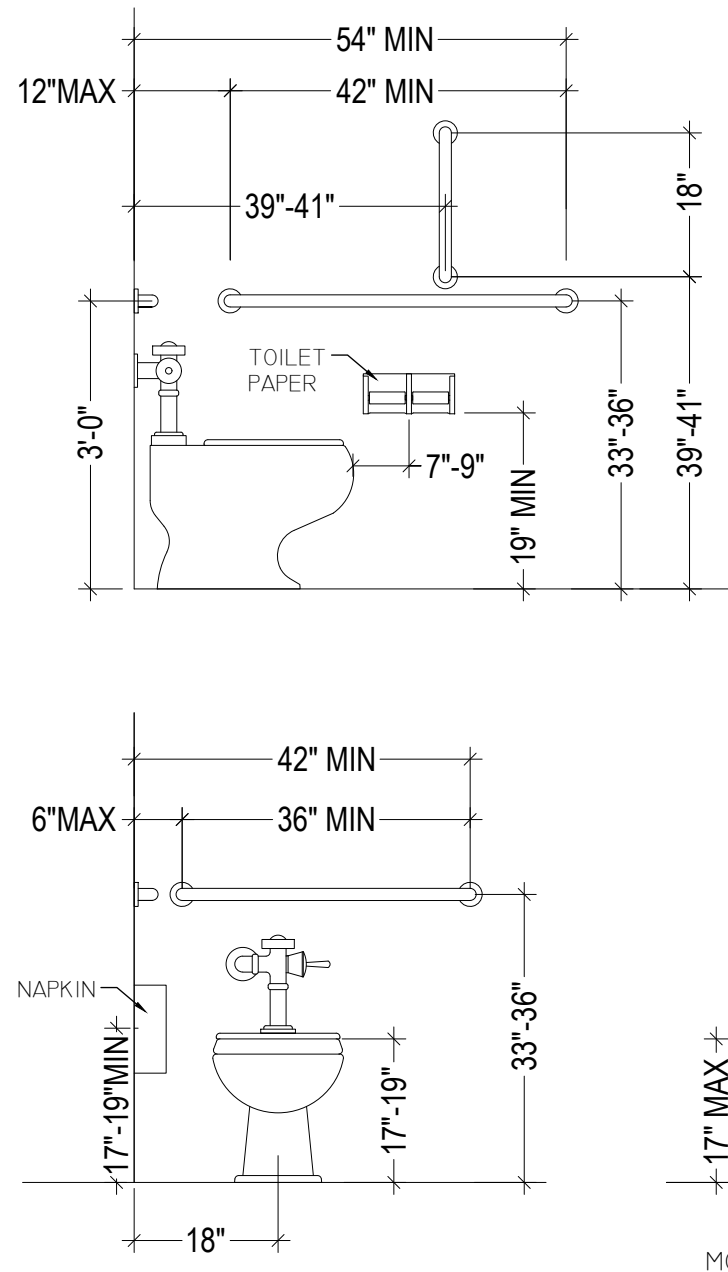

FIRE
EXTINGUISHER
CABINET